



ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
 (Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)
 ERDA Road, MaKarpura Industrial Estate, Vadodara-390 010, India.
 EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043128 / 29 / 30 / 31 / 33
 Fax : +91 (0265) 2638382
 E-mail : erda@erda.org
 Web : http://www.erda.org



TEST REPORT

SHEET: 1 OF 4

NAME & ADDRESS OF CUSTOMER MRM PROCOM PVT. LTD. Plot No. 20-21, Industrial Estate, Sector-59, Phase-II, Faridabad-121004, Haryana.	TEST REPORT NO.: RP-1516-015949 DATE : 27.07.2015	
	CUSTOMER REF. NO. : Nil	DATE : 07.07.2015
	DATE OF SAMPLE RECEIPT	DATE OF TESTING
	08.07.2015	09.07.2015 to 20.07.2015
SAMPLE DESCRIPTION CURRENT TRANSFORMER MFD. BY : MRM PROCOM PVT. LTD. RATIO : 400/5 A BURDEN : 10 VA CLASS : 0.5 H.S.V./I.L. : 0.66/3 kV FREQUENCY : 50 Hz. Insulation Class : E TYPE : RC/BPL	SAMPLE IDENTIFICATION SR. NO. : 2015070416 ERDA SAMPLE CODE NO. : ERDA-00098797 DRAWING NO. : MRM/CT/400-5-0.5/0715/11 REV.-00 SHEET NO. 11	
	ENCLOSURE : Annexure-I (As per sheet 1 of 1)	
TEST DETAILS & TEST SPECIFICATION ARE AS PER SHEET NO. 2 OF 4.		
TEST RESULTS : As per sheet: 3 of 4 to 4 of 4.		
REMARKS : The sample conforms to the requirements of the mentioned standard as mentioned in tests no. 1 to 6 on sheet no. : 2 of 4.		
 PREPARED BY	 CHECKED BY	 APPROVED BY (S.B.PATEL)

Note: 1. This report relates only to the particular sample received in good condition for testing at ERDA.
 2. This report cannot be reproduced in part under any circumstances.
 3. Publication of this report requires prior permission in writing from Director, ERDA.
 4. Only tests asked for by the customer have been carried out.
 5. In case of any dispute, Vadodara will be the exclusive jurisdiction & shall be construed as where the cause has arisen.

Caution: ERDA is not responsible for the authenticity of photocopied or reproduced test reports. ERDA provides support to customers for verification of the authenticity of test reports issued by ERDA.

1753114





ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION

(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)

ERDA Road, Makarpura Industrial Estate, Vadodara-390 010, India.

EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043128 / 29 / 30 / 31 / 33

Fax : +91 (0265) 2638382

E-mail : erda@erda.org

Web : http://www.erda.org



TEST REPORT NO. : RP-1516-015949

SHEET : 2 OF 4

DATE : 27.07.2015

TEST DETAILS & TEST SPECIFICATION:

Sr. No.	TESTS	REFERENCE STANDARD
1.	Verification of terminal marking and polarity.	Cl. No. 9.2 of IS 2705 (Part 1) : 1992
2.	Power frequency dry withstand test on primary winding.	Cl. No. 9.3 of IS 2705 (Part 1) : 1992
3.	Power frequency dry withstand test on secondary winding.	Cl. No. 9.4 of IS 2705 (Part 1) : 1992
4.	Over voltage inter-turn test.	Cl. No. 9.5 of IS 2705 (Part 1) : 1992
5.	Determination of errors according to the requirements of the appropriate accuracy class.	Cl. No. 7.2.1 of IS 2705 (Part 2) : 1992
6.	Temperature rise test.	Cl. No. 9.7 of IS 2705 (Part 1) : 1992

PREPARED BY

CHECKED BY



1753113



Certificate No. : T-0071

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION

(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)

ERDA Road, Makarpura Industrial Estate, Vadodara-390 010, India.

EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043128 / 29 / 30 / 31 / 33

Fax : +91 (0265) 2638382

E-mail : erda@erda.org

Web : http://www.erda.org



TEST REPORT NO. : RP-1516-015949

SHEET : 3 OF 4

DATE : 27.07.2015

TEST RESULTS:

1. **Verification of terminal marking and polarity.**

(Cl. No. 9.2 of IS 2705 (Part 1) : 1992)

Primary winding terminals : P1-P2

Secondary windings terminals : S1-S2

Terminal marking & polarity was found Ok.

Terminal marking was found marked clearly & Indelibly.

REMARK: Conforms

2. **Power frequency dry withstand test on primary winding.**

(Cl. No. 9.3 of IS 2705 (Part 1) : 1992)

The power frequency voltage of 3 kV rms was applied between the primary winding terminals and earth for one minute duration. The secondary windings terminals were connected together to earth.

The sample withstood the test voltage without any disruptive discharge.

REMARK: Conforms

3. **Power frequency dry withstand test on secondary winding.**

(Cl. No. 9.4 of IS 2705 (Part 1) : 1992)

The power frequency voltage of 3 kV (rms) was applied between the secondary windings terminals (all) connected together and the earth. The primary winding terminals were shorted and connected to the earth. The test voltage was applied for one minute. There was no disruptive discharge observed.

The sample withstood the test voltage satisfactorily.

REMARK: Conforms

4. **Over voltage inter-turn test. (Cl. No. 9.5 of IS 2705 (Part 1) : 1992)**

With the primary winding open circuited, a voltage at rated frequency was applied to the secondary winding terminals (S1-S2) such as to produce a secondary limiting current of rms value equals to rated secondary current (i.e. 5 amp.) for one minute.

The sample withstood the applied voltage satisfactorily for one minute.

REMARK: Conforms

1753112

PREPARED BY

CHECKED BY





Certificate No. : T-0071

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION

(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)

ERDA Road, Makarpura Industrial Estate, Vadodara-390 010, India.

EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043128 / 29 / 30 / 31 / 33

Fax : +91 (0265) 2638382

E-mail : erda@erda.org

Web : http://www.erda.org



TEST REPORT NO. : RP-1516-015949

SHEET : 4 OF 4

DATE : 27.07.2015

5. Determination of errors according to the requirements of the appropriate accuracy class. (Cl. No. 7.2.1 of IS 2705 (Part 2) : 1992)

PHASE ANGLE ERROR IN MIN.	RATIO ERROR IN %	% OF RATED CURRENT	RATIO ERROR IN %	PHASE ANGLE ERROR IN MIN.
---------------------------	------------------	--------------------	------------------	---------------------------

RATIO : 400/5 A, BURDEN : 10 VA, CLASS : 0.5

BURDEN: 100 % at 0.8 Lag. P. F.		BURDEN : 25 % at U. P. F.		
-0.43	-0.020	120	0.399	8.49
0.39	-0.054	100	0.388	9.41
14.54	-0.515	20	0.288	18.58
29.50	-1.069	5	0.080	31.57

REMARK: Conforms**6. Temperature rise test. (Cl. No. 9.7 of IS 2705 (Part 1) : 1992)**

A Continuous rated thermal current equals to 120% (i. e. $400 A \times 1.2 = 480 A$) of the primary current at rated frequency was circulated in the primary winding of the CT. Rated burden (i.e. 10 VA) was connected to the secondary winding terminals (i.e., S1-S2) of the CT. At steady state, temperature of the body and ambient temperature were recorded. The resistances of secondary winding were measured immediately after shut down and temperature rise calculated.

The temperature rises so obtained were as follows:

Sr. no.	Temperature rise of :	Specified limit for temperature rise test.	Obtained value :
1.	Secondary winding (Resistance method)	70 °C	S1-S2 : 10.10 °C
2.	Body (Thermocouple method)	70 °C	10.8 °C
3.	Ambient temperature	40 °C	32.1 °C

REMARK: Conforms

1753111

PREPARED BY

CHECKED BY





Certificate No. : T-0071

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION

(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)

ERDA Road, Makarpura Industrial Estate, Vadodara-390 010, India.

EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043128 / 29 / 30 / 31 / 33

Fax : +91 (0265) 2638382

E-mail : erda@erda.org

Web : http://www.erda.org




Annexure-I

TEST REPORT NO. : RP-1516-015949

SHEET : 1 OF 1

DATE : 27.07.2015

PHOTOGRAPHS OF TEST SAMPLE

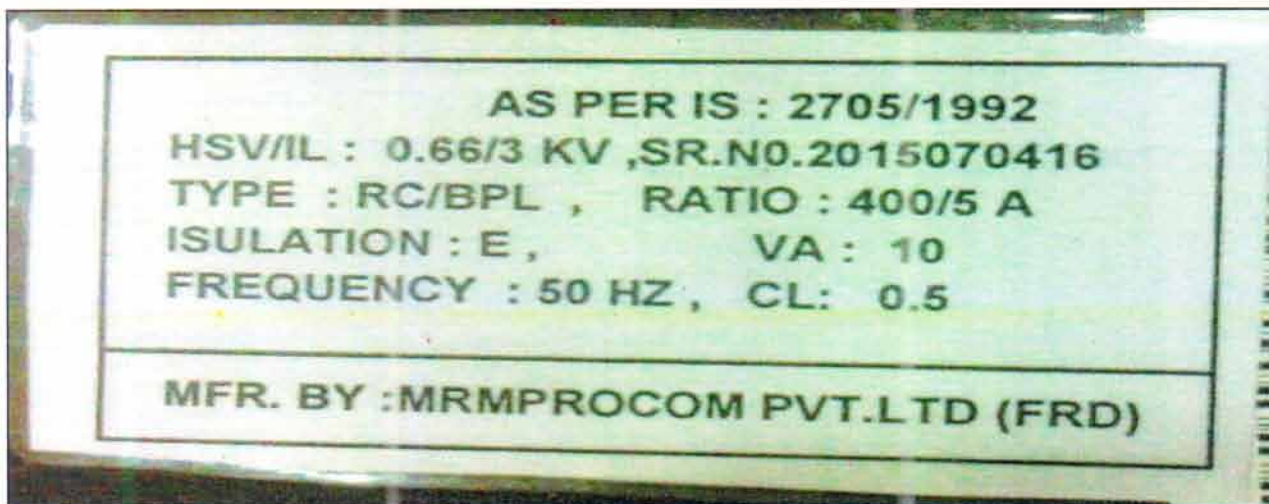

AS PER IS : 2705/1992
HSV/IL : 0.66/3 KV , SR.NO.2015070416
TYPE : RC/BPL , RATIO : 400/5 A
ISULATION : E , VA : 10
FREQUENCY : 50 HZ , CL: 0.5

MFR. BY : MRMPROCOM PVT.LTD (FRD)

1753129

PREPARED BY

CHECKED BY



Test Report No. **RP-1516-015949**
 Date : **23.07.2015**
 Product : **CT**
 Verified By : **Atgajewney**
 Verification of this drawing by ETEA is limited to relevant dimensional checks only. Verified dimensions are marked with *



 <p>MRM PROCOAM PVT. LTD. <small>PLLOT 50 30-21, REC 39, PH-2, FARIDABAD</small></p>	<p>(a) As per IS:2705/1992 HSV/IL : 0.66/3KV Type : RC/BPL Insulation : E Frequency : 50Hz</p>	<p>(b) Sr. No. 2015070416 Ratio: 400/5A V.A: 10 Class: 0.5 Dimensional Tolerance $\pm 5\%$</p>	<p>(c) Drawn : Harvinder Singh Checked/ Approved : Pankaj Gupta Scale : N.T.S. Date : 02/07/2015</p>	<p>(d) Dwg. No. : MRM/CT-400-5-0.5/0715/11 Rev. : (0) Sheet No : 11 No. of Sheets : 14</p>
---	--	---	---	---